
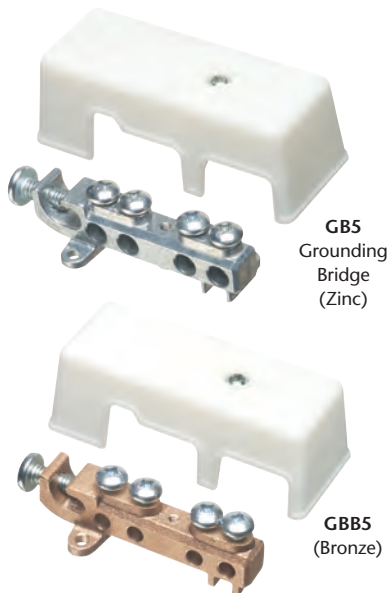


NEW!
more on reverse

Grounding Bridge in Zinc and Bronze

Meets 2008 NEC Ground Requirements

NEW!

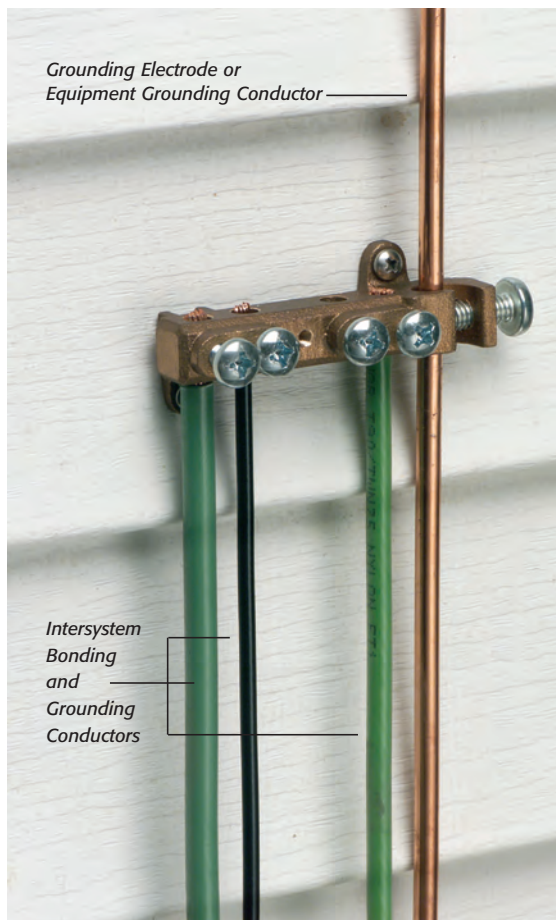


Arlington's heavy-duty Grounding Bridge provides reliable intersystem bonding between power and communication grounding systems.

They have **four** termination points; *one more than required* by 250.94 of the 2008 NEC.


Available in zinc (GB5) and bronze (GBB5 and GBB50), our new Grounding Bridge has the capacity to handle multiple hookups of communications systems; telephone, CATV or satellite dish.

- For indoor or outdoor use
- **Intersystem Bonding and Grounding Conductors:** All accommodate #14 to #4 copper or aluminum, solid or stranded
- **Grounding Electrode Conductor or Equipment Grounding Conductor:** GB5 and GBB5 accept #6 to #2. GBB50 accepts #6 to #1/0. All can be used with copper or aluminum, solid or stranded.
- Fast, simple installation
- Easy access for inspections
- For good looks – textured, paintable plastic cover

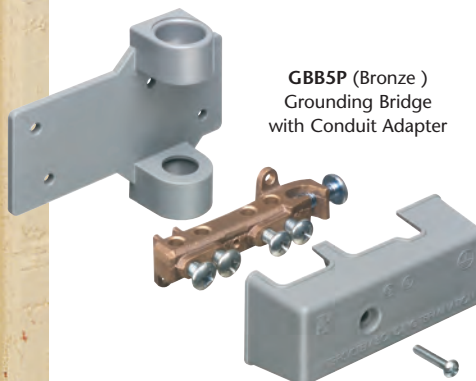

not shown
GBB50P (bronze)
GB5P (zinc)

Also available...Grounding Bridge in zinc and bronze, with an adapter for use with PVC conduit.



A
Arlington




1 Stauffer Industrial Park
Scranton, PA 18517
800/233.4717
Fax 570/562.0646
www.aifittings.com
www.arlnew.com/gb

**Meets NEC 2008
Ground Requirements**

Grounding Bridge in Zinc and Bronze




Intersystem Bonding Between Power & Communication Grounding Systems

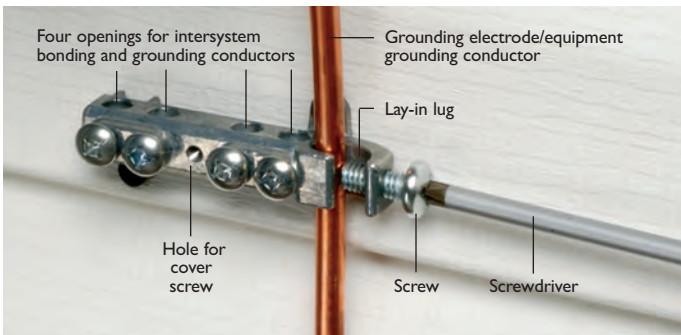


GB5, GBB5, GBB50 Installation

- 1 Attach Grounding Bridge to surface (screws not provided).
- 2 Insert grounding electrode conductor or equipment grounding conductor into the lay-in lug. Tighten screw.
- 3 Attach textured, paintable cover with the screw provided.
- 4 Remove cover for intersystem utilities (CATV, phone, etc). Add bonding/grounding conductors. Reinstall cover.

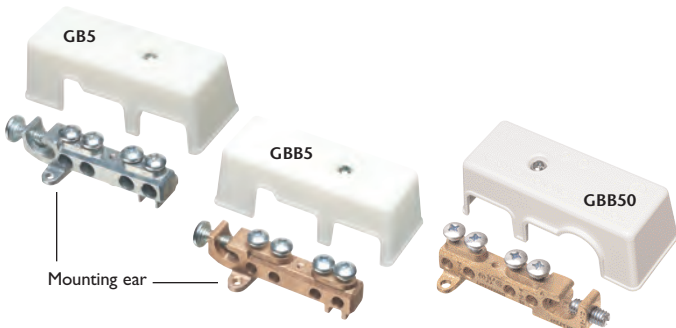

Catalog Number	UPC/DEI/NAED Mfg. #018997	Description	Grounding Electrode or Equipment Grounding Conductor	Unit Pkg	Std Pkg
GB5	76095	Zinc	#6 to #2 CU/AL	1	10
GBB5	76096	Bronze	#6 to #2 CU/AL	1	10
GBB50	09725	Bronze	#6 to #1/0 CU/AL	1	10

All handle #14 to #4 intersystem bonding/grounding conductors

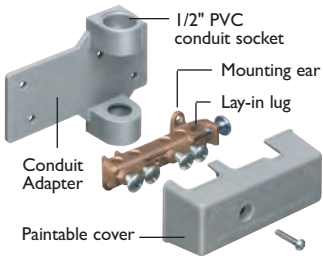

GB5P, GBB5P, GBB50P Installation



- 1 Mount conduit adapter plate in the desired location (screws not provided). Leave hole in lower left open for #2. Install PVC conduit in adapter with PVC glue (not supplied). Install grounding electrode conductor in conduit.
- 2 Install Grounding Bridge onto grounding electrode/equipment grounding conductor using lay-in lug. Tighten screw. Using two screws (not provided), attach Grounding Bridge to structure through holes in adapter plate.
- 3 Install paintable cover.
- 4 Remove cover for intersystem utilities (CATV, phone, etc). Add bonding/grounding conductors. Reinstall cover.

Catalog Number	UPC/DEI/NAED Mfg. #018997	Description	Grounding Electrode or Equipment Grounding Conductor	Unit Pkg	Std Pkg
GB5P	09720	Zinc w/ conduit adapter	#6 to #2 CU/AL	1	10
GBB5P	09721	Bronze w/ conduit adapter	#6 to #2 CU/AL	1	10
GBB50P	09726	Bronze w/ conduit adapter	#6 to #1/0 CU/AL	1	10

All handle #14 to #4 intersystem bonding/grounding conductors



Arlington
 1 Stauffer Industrial Park
 Scranton, PA 18517
800/233.4717
Fax 570/562.0646
www.aifittings.com
www.arlnew.com/gb

Patents pending
 GBs 0110/25M

Distributed by